

Committee Opinion

OPC Reference #1107.2

Log # 0005-05

Date Received 10/20/05


Date to Committee 10/24/05

Date to Board 1/10/06

Approved to Released 1/10/06

QUESTION:

Can an emergency roof drain discharge directly under the roofline, onto the exterior building wall, or does the discharge piping have to come down the wall to a safe level?

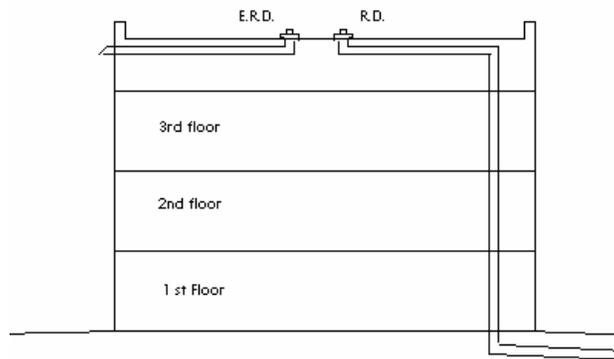

OPINION:

It is the opinion of this committee, that it can discharge as shown in drawing. Our answer is yes.

Final Vote 15/0

This opinion is not meant to be a binding code interpretation.